
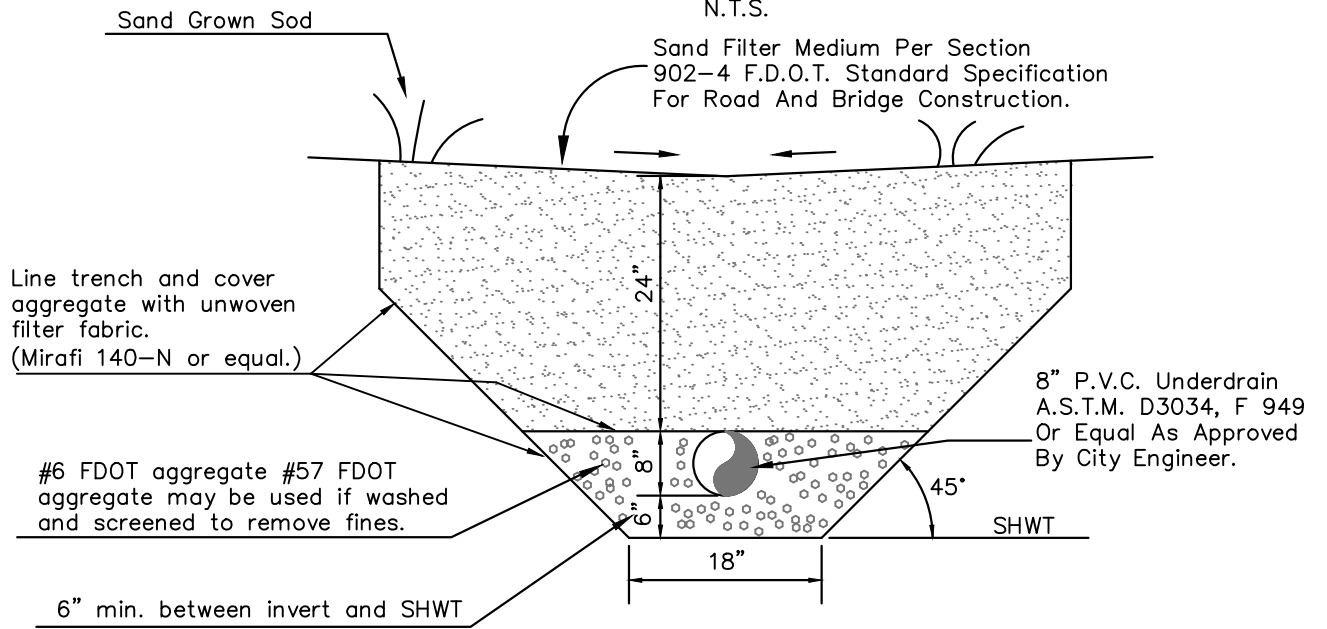


**NOTES:**

1. Install min 8" underdrain pipe or 6" pipe (per FDOT requirements) if approved by the City Engineer.
2. No ADS pipe shall be used for underdrain on City projects.
3. Invert of the underdrain pipe shall be a minimum of 6" above the established Seasonal High Water Table (SHWT).

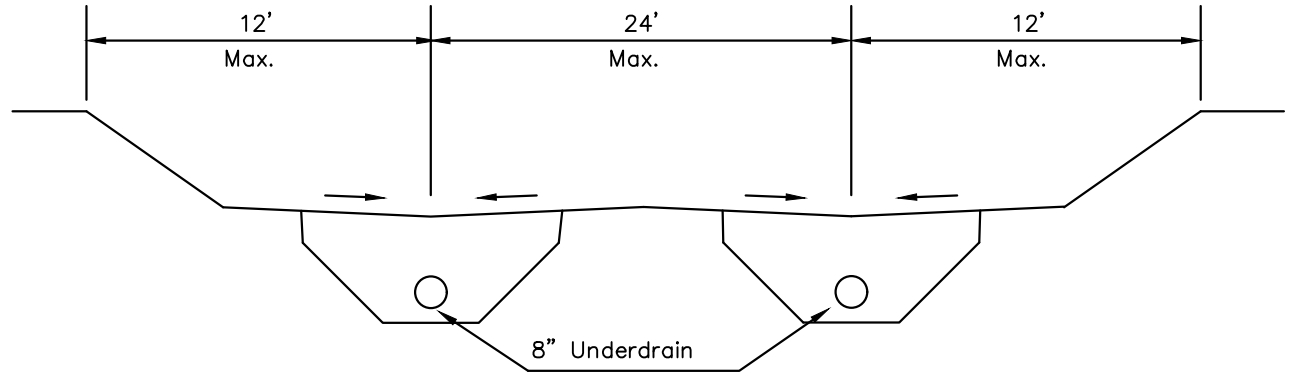

6/16/15	CHANGE 8" UD.	S.R.
DATE	REVISION DESCRIPTION	APP

**CITY OF CLEARWATER**  
ENGINEERING DEPARTMENT  
**STORM**  
**DETAILS**

**UNDERDRAIN DETAIL FOR**  
**DRY DETENTION AREAS**

INDEX NO.	PAGE NO.
217	1 OF 1
LATEST REVISION	2/22/2016